4 □□□□□ □□ □□□□□□ □□□□□ □□□□ □□ □□□□□ □□□□ □□□ NC NC □□□□□□□ □□□□

□□□□ □□□□ EB-117B□

DO NOT PAINT

DO NOT PAINT

4-Wire photoelectric smoke detector
MADE IN CHINA

4-Wire photoelectric smoke detector
MADE IN CHINA

Q.C.
PASSED
COM
L1

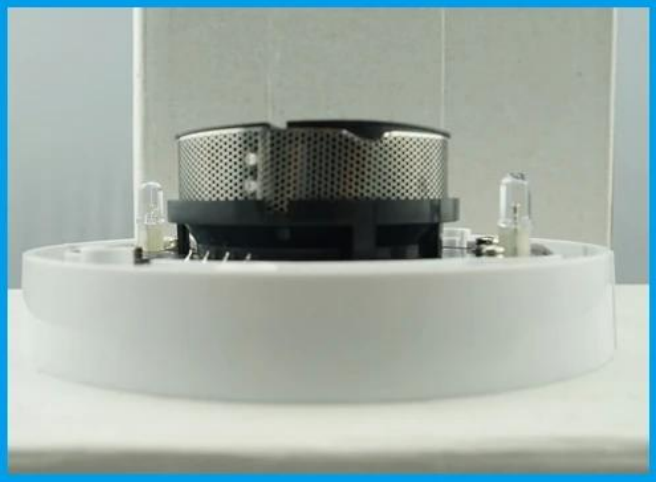

Q.C.
PASSED
L2
L1
NC/NO
COM

□□□□□□□□□ □□□□□□ □□□ □□□ EB-117B□

EB-117B'S MAIN PARAMETER

□□□ □□□□□□:	4 □□ □□□□□□ □□□□□□ □□□□□ □□□ □□□□□□ □□□□ NO NC □□□□ □□□□□□□□ □□□□□□□
□□□□□□□ □□□:	EB-117B
□□□□□ □□□:	DC 9 ~ 35V
□□□□□ □□□□□□□:	**4** □□□□□□□ □□□ □ □□□□□□ □□□□□□ □ **+** □□□□□□ □□□□□□) □□□□ **(COM)** □ □□□ □□□□□□□ **(NO □□ NC)**
□□□□:	100 □□) 60 * □□□)
□□□□□ □□□□□:	**20** □□□ □□□□
□□□□□□□ □□□□□	□□□ □□□ □□□□□□ □□□□□□
□ □□□□□:	□□□□□□ □□□□□ □□□□ □□□□
□□□□□□□ □□□□□:	□□□□□ □□□
□□□□□ □□□□□ □□□□:	-10 □□□□□ □□□□ **50+ ~** □□□□□ □□□□□
□□□□□ □□□□□:	0 ~ 90□ RH (□□□□□ □□□□)
□□□:	0.18KG
□□□□:	2 □□□ LED
□□□□:	ABS □□□□ □□□□□□ □□□□□ □□□□□□□ □□□□□ + □□□□□
□□□□□ □□□:	□□□□
□□□□:	2 □□□□□□ □□□
OEM:	□□□□□□□ □□□□□□□ □□□□□ □□□□

□□□□□□□□□ □□ EB-117B □□□□□

1.4 wire fire alarm system photoelectric smoke detector

2.Working power 9~35V DC

3.Standby current :2 mA(24V NO), 13mA(24V NC)

4.Alarm current:18 mA(24V NO),6 mA(24V NC)

5.Alarm indication:Red LED on

6.Wire port: POWER+(In)/POWER-/ COM/

7.Suitable for fire alarm panel system

8.Conformed EN54-7/UL268 standard

9.2 years warranty , welcome OEM

□□□□ □□□ EB-117B□

4 wire detectors wiring diagram

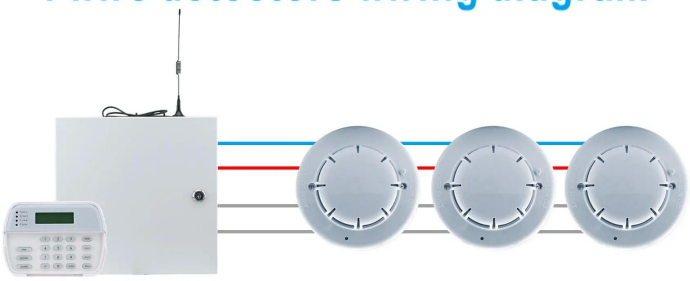

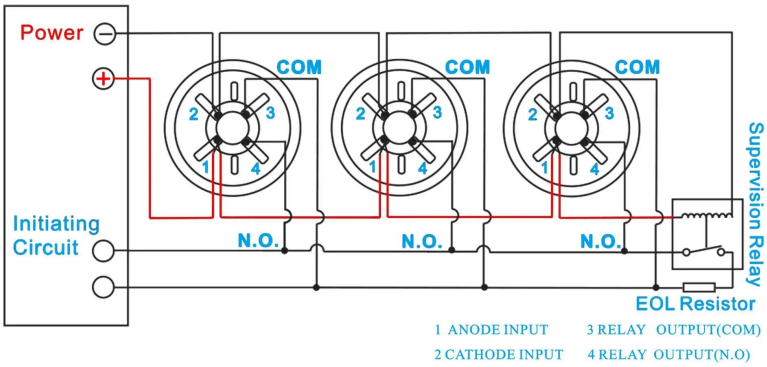

PCB board display

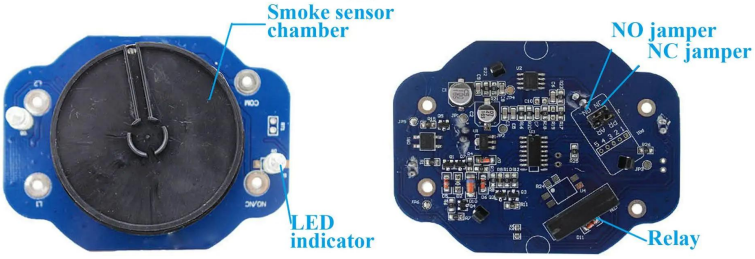

Where to installation?

Mall

Library

Bank

□□□□ □□□□ □□□ □□□

SMQT
铭汗科技
SMQT
铭汗科技
SMQT
铭汗科技
SMQT
铭汗科技
SMQT
铭汗科技
SMQT
铭汗科技