Parameter

SMQT

□□□□□□□□	
□□□□□□□ □□□	□□□□□□□ □□□□□□□□ □□□□□□□□ □□□ □□□□□□□ □□□□ □□□ □□□□□□□
□□□□□□□ □□□	□ 37-□□□□
□□□□□□	182 76 * □W * 62 □□□) □)
□□□□□□□ □□□□□□	DC12V
□□□□□□□ □□□□□□□□	3A
□□□□□□□□ □□□□□	36W
□□□□□□□□ □□□□□□□□	COM/NC/□□/GND/+ 12V/□□□□□□□/□□□
□□□□□□ □□□□□□	0-10s
□□□□□□ □□□□□□	□□□□□□□□ □□□□□□□ □□□□□ □□□□□□□ □□□□□□ □□□□□□□□□□ □□
□□□□□□ □□□□□□	□□□□□□□□ □□□□□□□□ □□ □□□□□□
□□□□□	□□□□□□ □□□□□ □□□□□ □□□□□□□□□ □□□□□□□

Introduction

SMQT

□□□□□□□ □□□□□□ □□□□□□□□□□ □□□□□□□□□ □□□□□□□ □□□□□□ □□ "□□□□□□□ □□□□□□□□ □□□□□□□" □□□□ □□□□□□□
□□□□□□□ □□□□□□ □□ □□□□□□□ □□□□□□ □□□□□□□ □□□□□□□□□□
□□□□□□□□ □□□□□□□□ □□□□□□ □□□□□ □□□□□□□□ □□□□□□ □□□□.
12 □□ □□□□□□□ □□□□□□□ □□□□□□□□ □□□□□□ □□ □□□□□□ □□□□□□□□ □□□□□□□ □□□□□VDC□ □□□□□□□□ □□□□□□ □□
□□□□□□□□□□
□□□□□□□ □□□□□□□□ □□□□□□ □□□□□□□□ □□□□□□□□ □□□□□□□□□ □□□□□□□□ □□□□□□.

Dimesion Picture

SMQT

Installations

SMQT

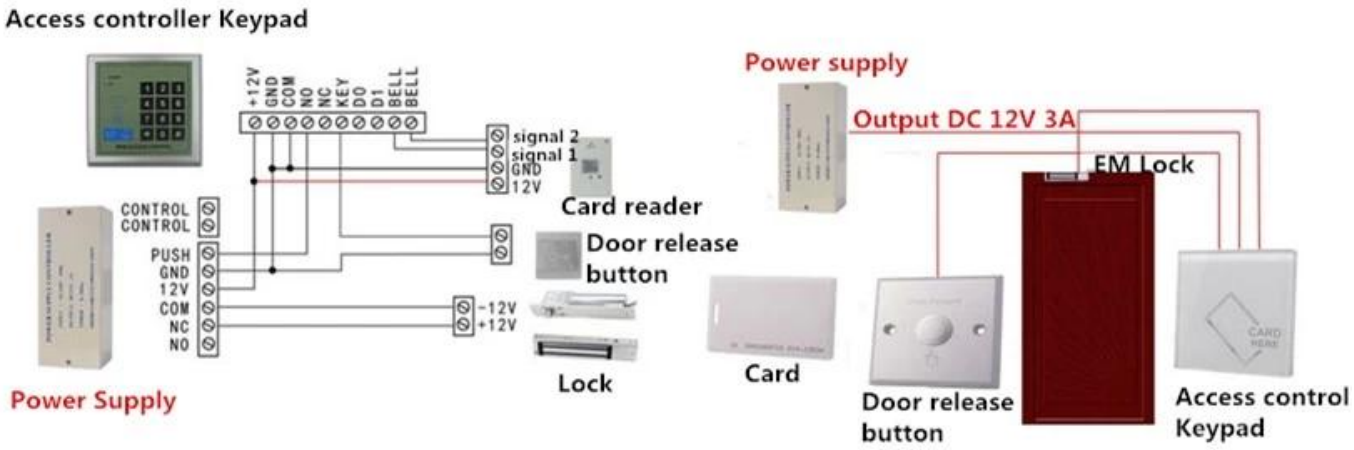

Features

SMQT

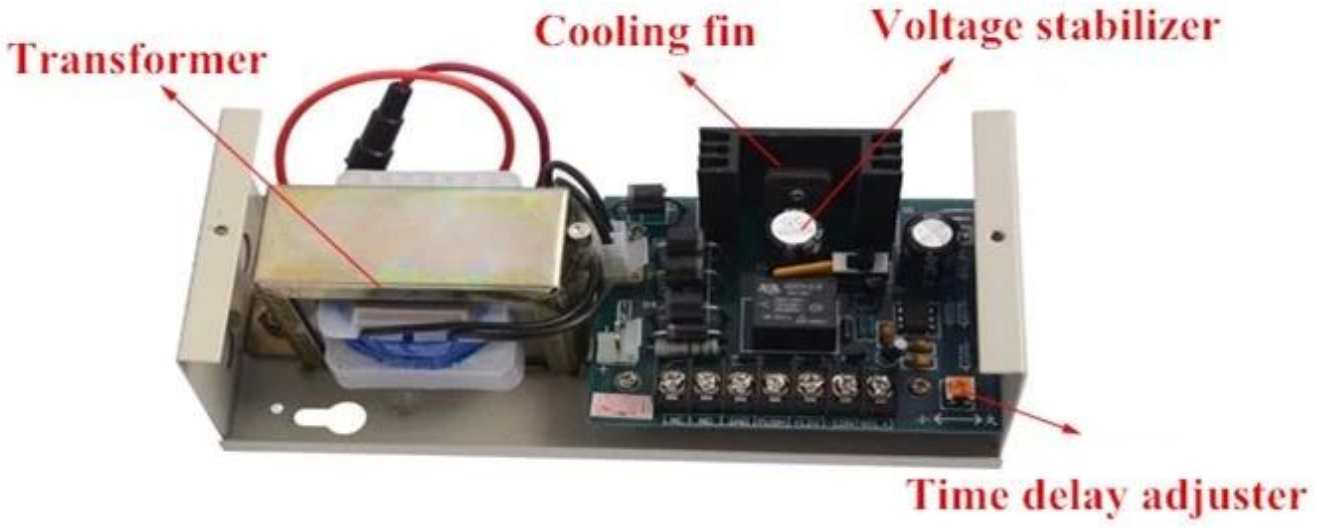

Packing list

SMQT

□□□□□□□□ □□□□□□□ □□□□□	
□□□□□□	20pcs/□□□□
□□□□□□□ □□□	43.8 39.8 * □W * 16.5 □□) □)
□□□□□□□ □□□	25.38 □□□

POWER SUPPLY CONTROLLER
INPUT : AC220V , 50Hz
OUTPUT: DC12V , 3A
TIMER : 0~10Sec
SHORT CIRCUIT PROTECTION

Office

SMQT

Exhibitions

SMQT

2011 Brazil Fair
2012 Shenyang Fair
2013 Jinan Fair
2013 Shenzhen Fair
共赢
.....
2012 Shenyang Fair
2013 Shenyang Fair
2013 Shenzhen Fair
2015 Shenzhen Fair