

SMQT 4 無線電波 警報器 無線電波 警報器



無線電波 警報器 無線電波 警報器 EB-1178







**1.Wired heat&photoelectric smoke detector**

**2.Working power 9~36V DC**

3.Standby current : $\leq 0.2$  mA(12V NO) ;  $\leq 4$ mA(12V NC)

4.Alarm current:10 mA(12V NO),7 mA(12V NC)

5.Alarm indication:Red LED on

**6.Wire port: POWER+(In)/POWER-/ COM/NO or NC**

**7.Suitable for fire alarm system**

**8.Conformed GB4715 GB716 EN14604 standard**

**9.2 years warranty , welcome OEM**

□□□□ □□ **EB-1178**□












# Size



# Module Display

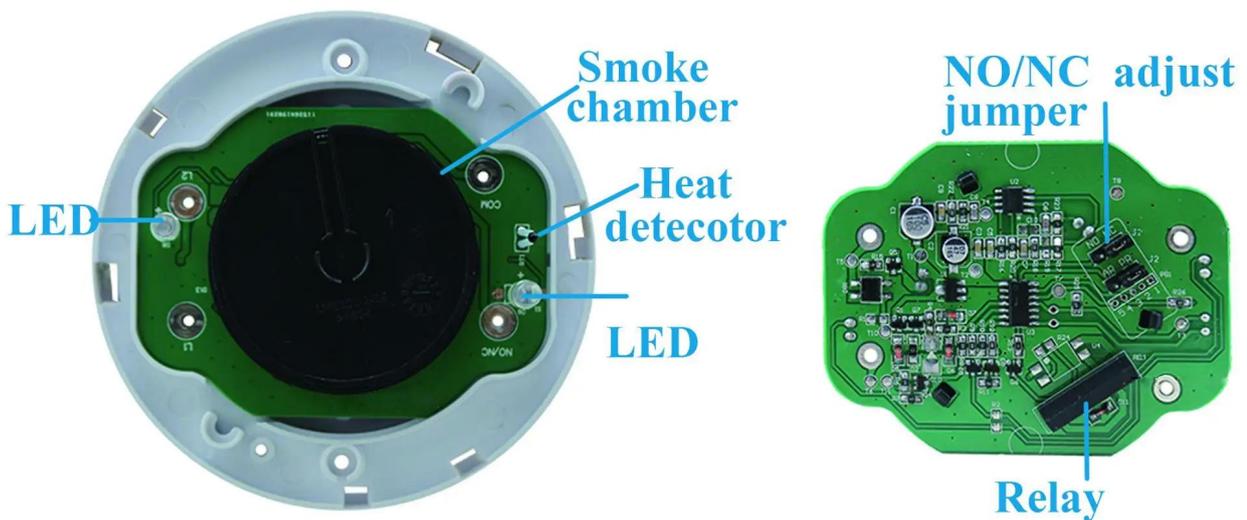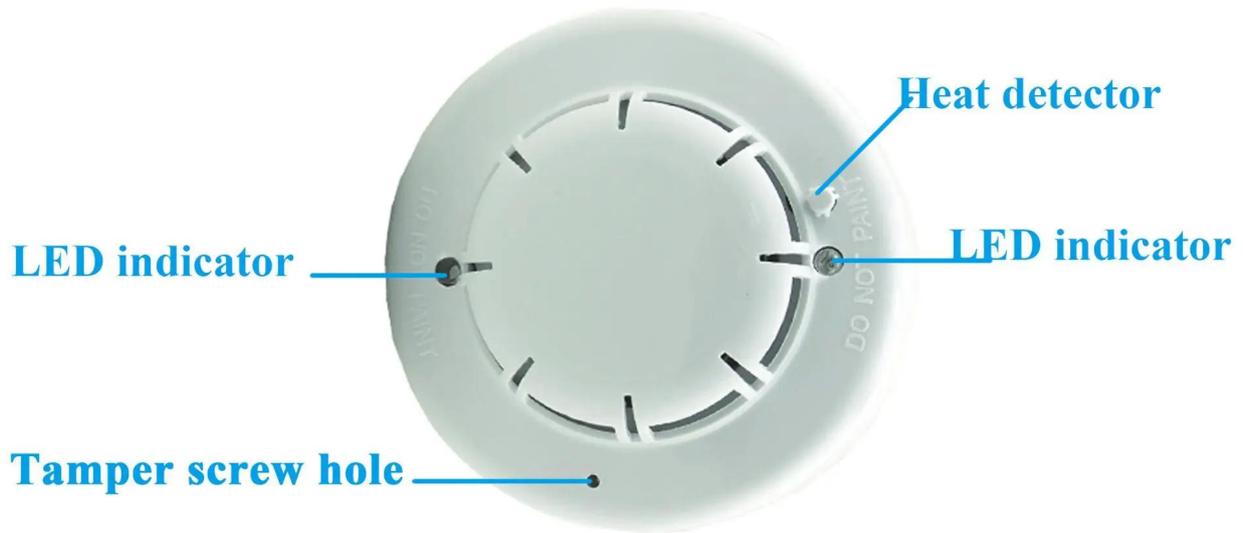

# How to connect wire?

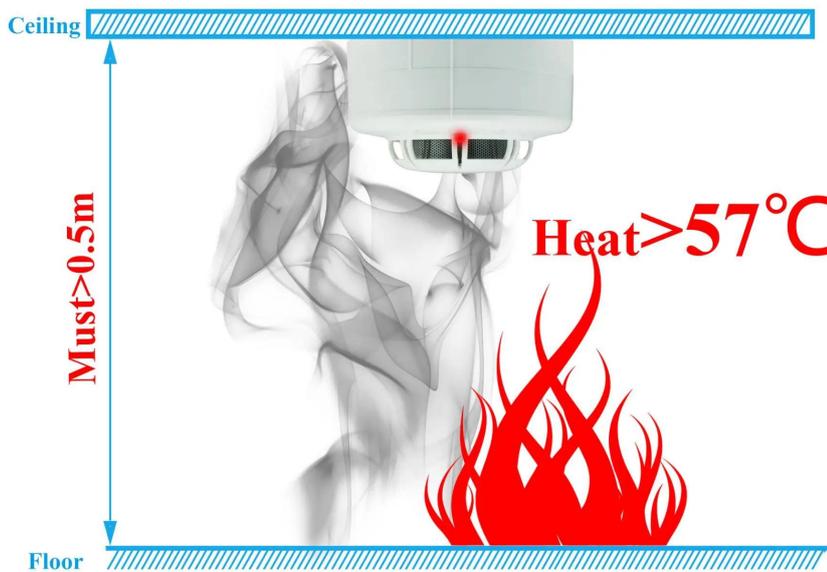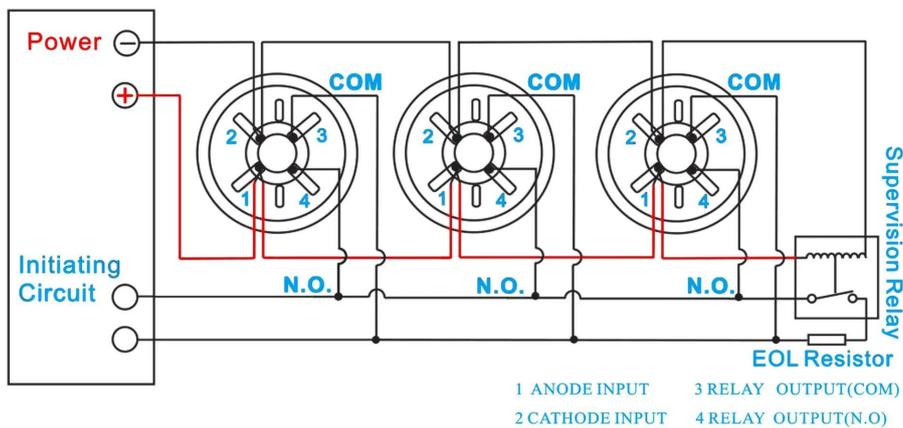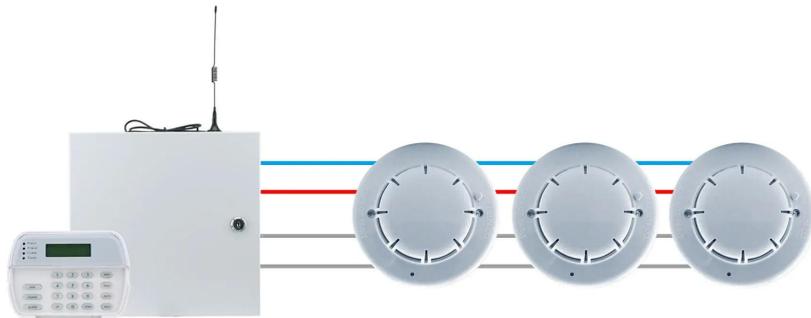

# Where to installation?



BANK



HOSPITAL



SCHOOL



COMPANY



HOME



MALL



HOTEL



APARTMENT

**SMQT**  
铭汗科技



**SMQT**  
铭汗科技



**SMQT**  
铭汗科技



**SMQT**  
铭汗科技



**SMQT**  
铭汗科技



**SMQT**  
铭汗科技

