

SMQT 4



EB-1178



EB-1178 □□□□□□□□□□



EB-1178 □□□□□

□□□□	SMQT 4 □□□□□□□□□□
□□□	EB-1178
□□□	DC 9~36V
□□□	103□□* 53□mm□
□□□	□□□□□□□□□□□□
□□□□	> 57 □□□□□□□□
□□□□	20 □□□□□□ 6 □□□□□□□□
□□□□	□□LED□□□&□□□□□□
□□□	□□
□□□□□	□□□□□□
□□□□□	-10 □□□□+ 50□□□
□□□□□	□□□□0~95□□□□□□
□□□	0.19 □□
LED □	2□LED□
□□□	ABS□□+ PCB□
□□□□□	□□
□□□	2□□□
OEM □	□□OEM

EB-1178□□□□□□



1. Wired heat&photoelectric smoke detector

2. Working power 9~36V DC

3. Standby current : ≤ 0.2 mA(12V NO) ; ≤ 4 mA(12V NC)

4. Alarm current:10 mA(12V NO),7 mA(12V NC)

5. Alarm indication:Red LED on

6. Wire port: POWER+(In)/POWER- / COM/NO or NC

7. Suitable for fire alarm system

8. Conformed GB4715 GB716 EN14604 standard



9. 2 years warranty , welcome OEM

EB-1178 □□□□




Size



Module Display

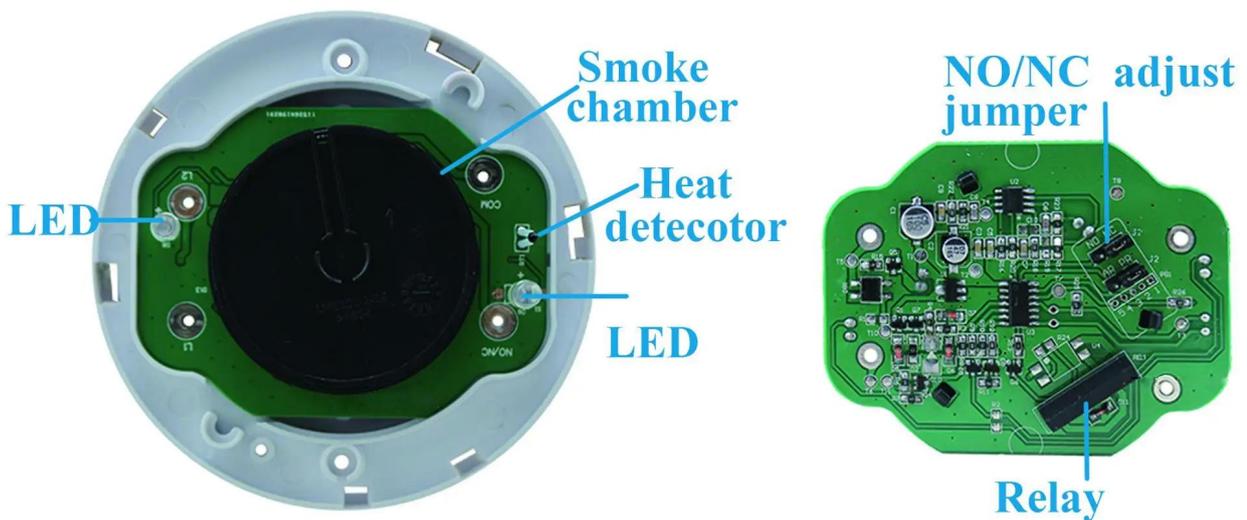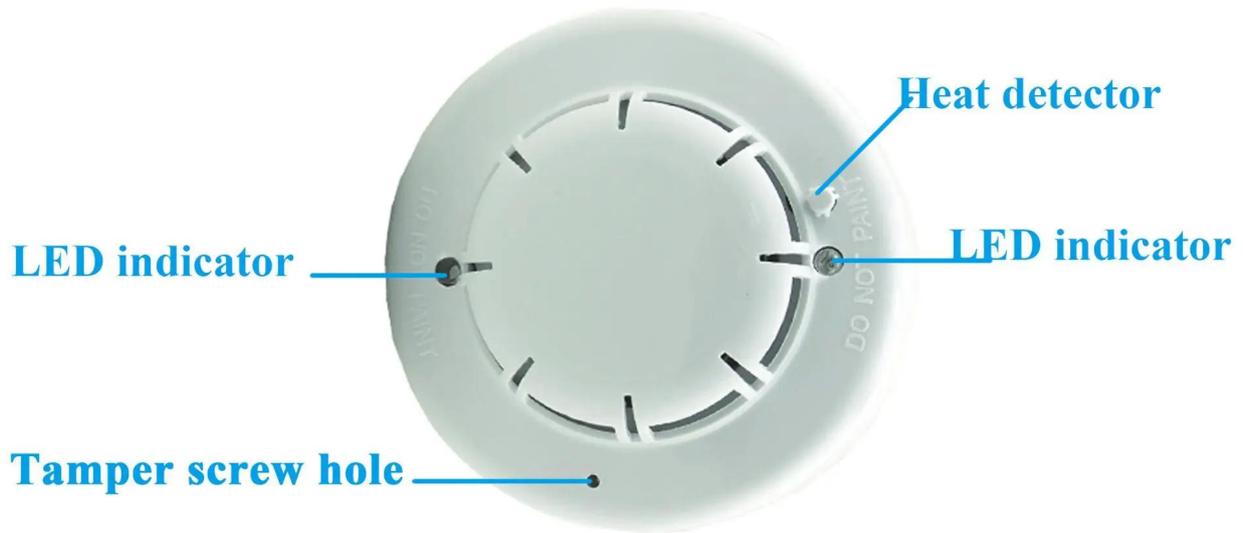

How to connect wire?

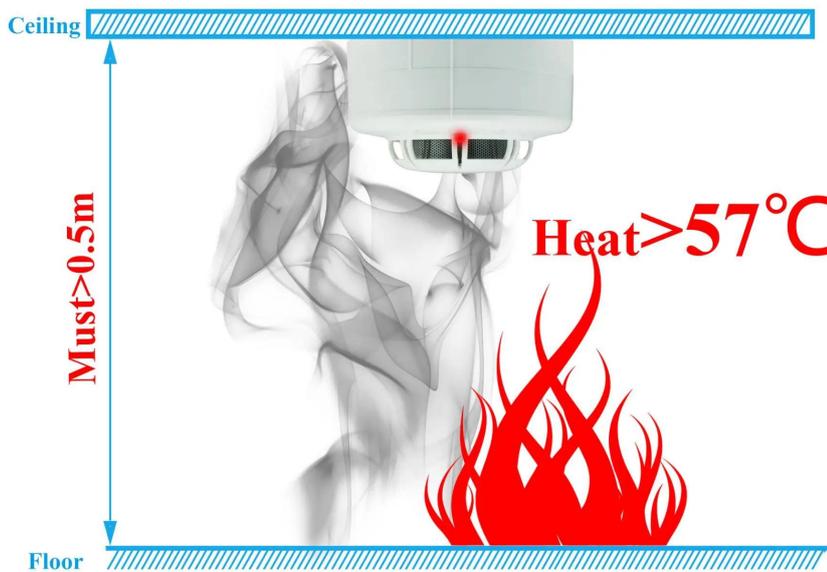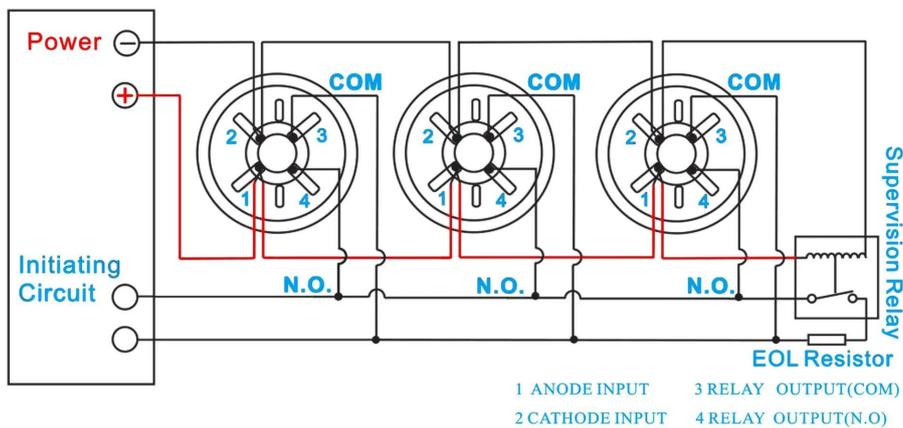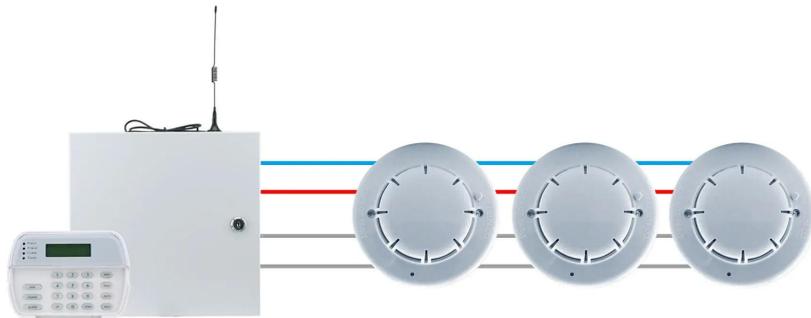

Where to installation?



BANK



HOSPITAL



SCHOOL



COMPANY



HOME



MALL



HOTEL



APARTMENT



SMQT
铭汗科技



SMQT
铭汗科技



SMQT
铭汗科技



SMQT
铭汗科技



SMQT
铭汗科技



SMQT
铭汗科技

