

[illegible]

SMQT 4



EB-1178 □□□□□□□□□□□□?



EB-1178?



EB-1178 PARAMETER

電源電圧:	5V SMQT 4
電源電流:	EB-1178
電源電圧:	DC 9 ~ 36V
電源:	103 * 53 (mm.)
電源電圧:	5V
電源電流:	> 57 mA
電源電圧:	20 mA (intallation 6 mm)
電源電流:	LED LED & 6 mm
電源電圧:	6 mm
電源電流:	6 mm
電源電圧:	-10 ~ 50
電源電流:	0 ~ 95% RH (mm)
電源電圧:	0.19kg
電源 LED:	LED 2 mm
電源電流:	ABS + PCB
電源電圧:	mm
電源電流:	2 mm
OEM:	OEM

████████████████████ **EB-1178** ███?



1.Wired heat&photoelectric smoke detector

2.Working power 9~36V DC

3.Standby current : ≤ 0.2 mA(12V NO) ; ≤ 4 mA(12V NC)

4.Alarm current:10 mA(12V NO),7 mA(12V NC)

5.Alarm indication:Red LED on

6.Wire port: POWER+(In)/POWER-/ COM/NO or NC

7.Suitable for fire alarm system

8.Conformed GB4715 GB716 EN14604 standard


9.2 years warranty , welcome OEM

□□□□□□□□□□ **EB-1178?**




Size



Module Display

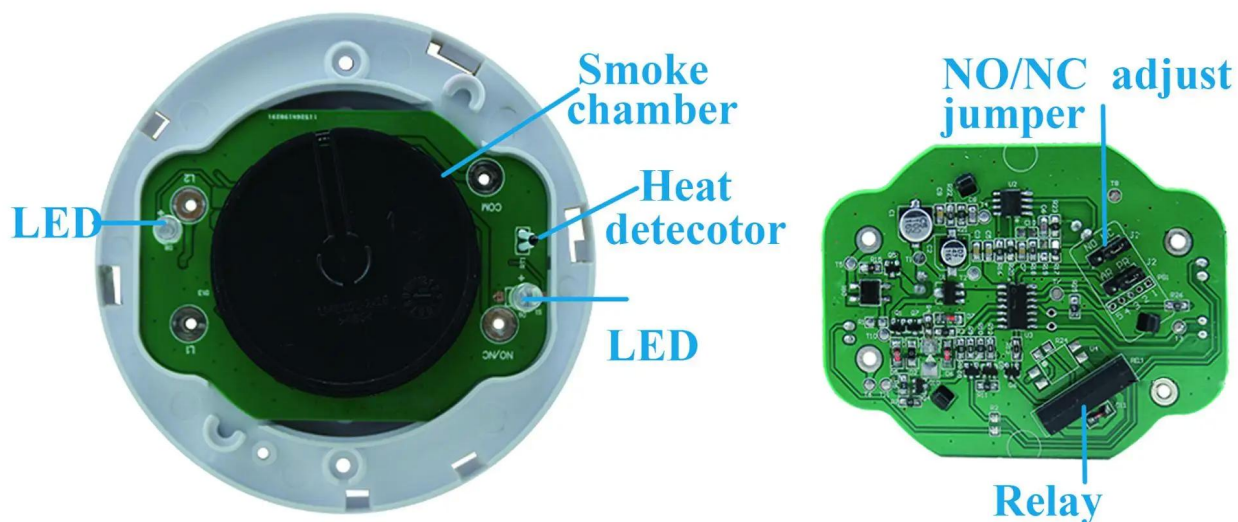

How to connect wire?

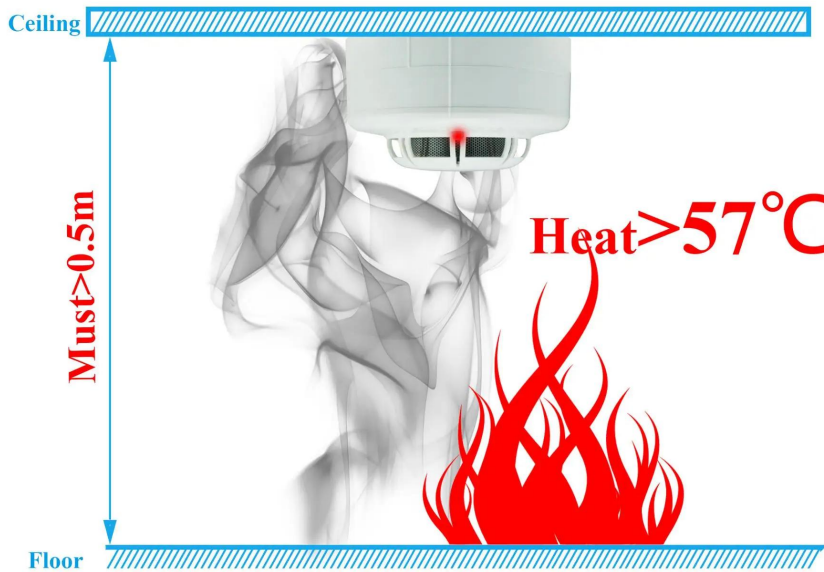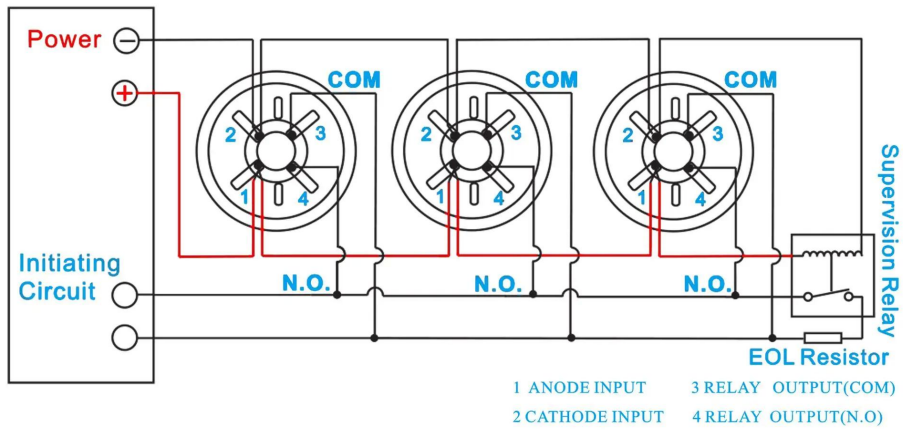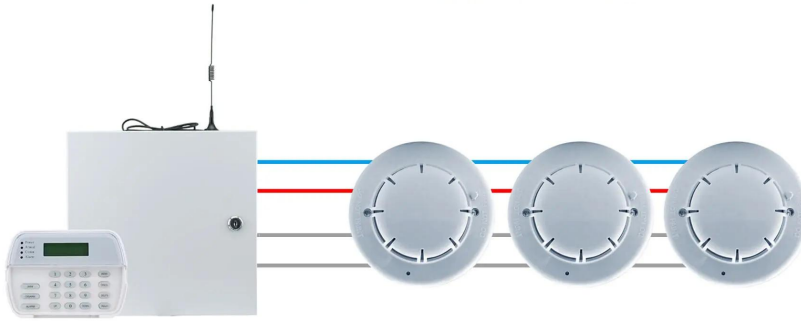

Where to installation?



BANK



HOSPITAL



SCHOOL



COMPANY



HOME



MALL



HOTEL



APARTMENT

SMQT
铭汗科技



SMQT
铭汗科技



SMQT
铭汗科技



SMQT
铭汗科技



SMQT
铭汗科技



SMQT
铭汗科技

